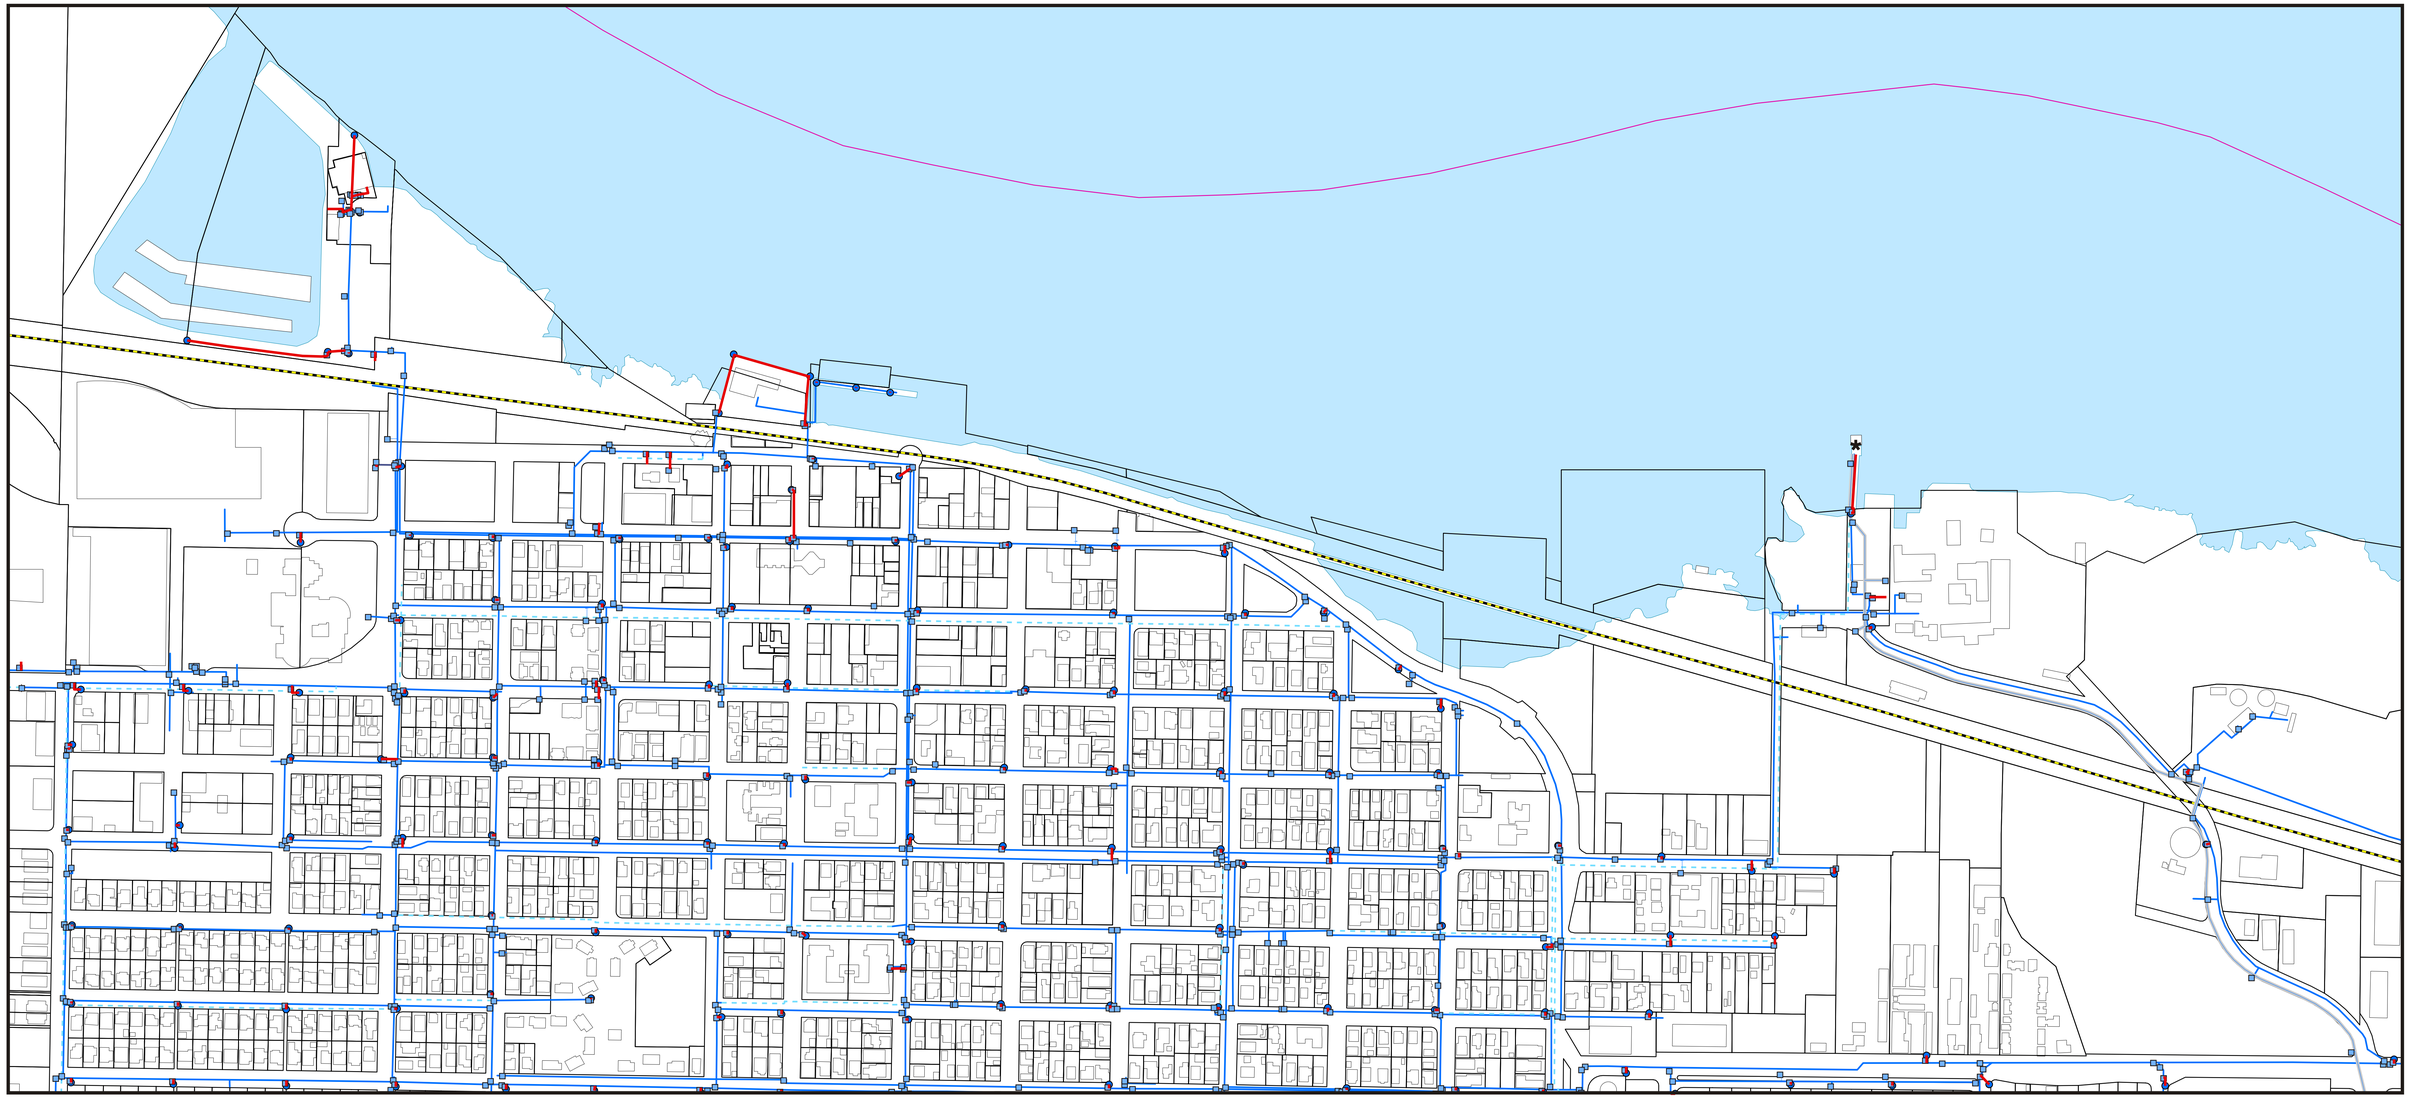

RIVERTOWN WATERFRONT MASTER DEVELOPMENT PLAN

INITIAL STUDY

LEGEND

Commercial	Raw Water
Domestic	Abandoned
Laterial	Valves
Fire	Hydrants
Location	River Pumps

0' 250' 500' 750'

North

Prepared For: City of Antioch
Prepared By: ARCADIS in association with Economic & Planning Systems, Inc.

Figure II-5

EXISTING INFRASTRUCTURE

Water Utilities

CITY OF ANTIOCH CALIFORNIA

RIVERTOWN DEVELOPMENT LLC